


Ad-hoc BS 5839-1: 2013 Section 26.2 e)

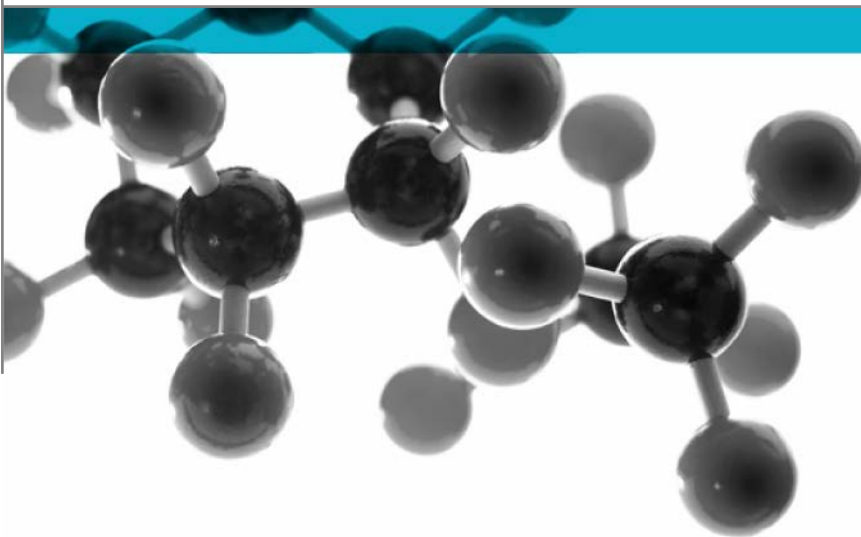

Ad-hoc investigation to determine the fire performance of a cable junction box, using the principles of BS 5839-1: 2013 Section 26.2 e)

A Report To: CE-TEK Controls & Enclosure Technik Ltd

Document Reference: 349800

Date: 10th March 2015

Issue No.: 1

Page 1

**Testing
Advising
Assuring**

Executive Summary

Objective To determine the fire performance of a cable junction box, using the principles of BS 5839-1: 2013 Section 26.2 e)



Generic Description	Product reference	Thickness	Density
A stainless steel cable junction box	"CEX151590FRF"	1.5mm	Not stated
Individual components used to manufacture composite:			
Terminals	"0.5/10FR Terminal"	Not stated	Not stated
Fuse	"6 Amp FR Fuse"	Not stated	Not stated
Please see pages 5 & 6 of this test report for the full description of the product tested			

Test Sponsor CE-TEK Controls & Enclosure Technik Ltd, Units 1-4 Tideswell Business Park, Tideswell, Derbyshire, SK17 8NY, UK.

Test Results: When tested using the general principles of BS 5839-1 Section 26.2 e), the cable junction box maintained its integrity for the duration of the tests.

Date of Test 3rd & 4th March 2015

Signatories

	
Responsible Officer C. Meachin * Technical Officer	Authorised S. Deeming * Business Unit Head

* For and on behalf of **Exova Warringtonfire**.

Report Issued: 10th March 2015

This version of the report has been produced from a pdf format electronic file that has been provided by **Exova Warringtonfire** to the sponsor of the report and must only be reproduced in full Extracts or abridgements of reports must not be published without permission of **Exova Warringtonfire**.

CONTENTS	PAGE NO.
EXECUTIVE SUMMARY	2
SIGNATORIES	2
TEST DETAILS	4
DESCRIPTION OF TEST SPECIMENS	6
PHOTOGRAPHS OF TEST SPECIMENS.....	8
TEST RESULTS	9
REVISION HISTORY	10

Test Details

Introduction

The sponsor, CE-TEK Controls & Enclosure Technik Ltd, approached **Exova Warringtonfire** and requested that a series of tests be conducted to demonstrate that their cable junction box comply with the requirements of BS 5839-1: 2013.

Section 26.2 e) of BS 5839-1 states:-

“Methods of cable support should be such that circuit integrity will not be reduced below that afforded by the cable used, and should withstand a similar temperature and duration to that of the cable, while maintaining adequate support”.

In order to demonstrate that the cable junction box meets the above requirements, it was used in conjunction with enhanced fire resisting cables whilst they were exposed to the test conditions given in BS 5839-1: 2013 Section 26.2 e).

Purpose of test

To determine the performance of cable junction box when it is subjected to the conditions of test specified in BS 5839-1: 2013, Section 26.2 e) and hence to demonstrate that they meet the requirements specified in Section 26.2 f). The purpose of the test methods are to determine whether a cable can maintain circuit integrity when it is exposed to the fire conditions described within the methods.

The tests were performed using the general principles of the procedures specified in BS 5839-1: 2013 Section 26.2 e), BS EN 50200: 2006 and BS 8434-2: 2003 + A2 2009 and this report should be read in conjunction with those standards.

Scope of test

Section 26.2 e) of BS 5839-1 describes two methods of test for enhanced fire resisting cables :-

a) The cable should meet the PH 120 classification when tested in accordance with BS EN 50200.

The PH 120 classification for the continuity of power supply is defined in the Interpretative Document No. 2 of the Construction Products Directive. Two results in which the measured duration of survival equals or exceeds the stated classification (i.e. 120 minutes) are needed to obtain the classification.

And

b) The cable should maintain circuit integrity when exposed to the following test:

‘A sample of the cable is simultaneously exposed to a flame at a temperature of 930 (+40 -0°C) and mechanical shock for 60 minutes, followed by simultaneous exposure to water spray and mechanical shock for a further 60 minutes.’

Compliance with this requirement is demonstrated using the test method described in BS 8434-2: 2003 + A2 2009.


Fire test study group/EGOLF	Certain aspects of some fire test specifications are open to different interpretations. The Fire Test Study Group and EGOLF have identified a number of such areas and have agreed Resolutions which define common agreement of interpretations between fire test laboratories which are members of the Groups. Where such Resolutions are applicable to this test they have been followed.
Instruction to test	The tests were conducted on the 3 rd & 4 th March 2015 at the request of CE-TEK Controls & Enclosure Technik Ltd, the sponsor of the test.
Provision of test specimens	The specimens were supplied by the sponsor of the test. Exova Warringtonfire was not involved in any selection or sampling procedure.
Conditioning of specimens	<p>The specimens were received on the 25th February 2015.</p> <p>Prior to the test the specimens were conditioned for at least 16 hours in an atmosphere having a temperature of $23 \pm 2^{\circ}\text{C}$ and a relative humidity of $50 \pm 5\%$.</p>
Form in which the specimens were tested	The cable junction box was mounted to a nominally 10mm thick calcium silicate backing board and used the standard cable supplied and described below.

Description of Test Specimens

The description of the specimens given below has been prepared from information provided by the sponsor of the test. All values quoted are nominal, unless tolerances are given.

General description		A stainless steel cable junction box	
Junction box	Product reference	"CEX151590FRF"	
	Name of manufacturer	CE-TEK Controls & Enclosure Technik Ltd	
	Thickness	1.5mm (stated by sponsor) 1.5mm (determined by Exova Warringtonfire)	
	Terminals	Product reference	"0.5/10FR Terminal"
		Detailed description / composition details	0.5mm ² - 10mm ² capacity fire rated terminals
		Name of manufacturer	CE-TEK
	Fuse	Product reference	"6 Amp FR Fuse"
		Detailed description / composition details	6 Amp fire rated fuse assembly
		Name of manufacturer	CE-TEK
Brief description of manufacturing process		The junction boxes are manufactured from 1.5mm thick stainless steel complete with sealed cover with high temperature low smoke halogen free gasket rated to IP67.	
The junction box was fitted to a calcium silicate backing board using stainless steel screws			
General description		Enhanced FR cable	
Product reference		"FP Plus"	
Name of manufacturer		Prysmian	
Diameter		11.5mm (stated by sponsor) 9.4mm (determined by Exova Warringtonfire)	
Weight per unit length		123kg/km (determined by Exova Warringtonfire)	
Cable marking		PRYSMIAN® 2015H LPCB 077g/02 FP PLUS LSOH BS7629-1 EN50200 PH120 BS8434-2 120MIN BS5839-1 ENHANCED	
Cable function		Power feed	
Colour		"Red"	
Number of cores x core size		3 x 2.5mm ²	
Voltage rating		300/500v	
Cable configuration		<ul style="list-style-type: none"> • Outer sheath • Aluminium screen tape • Conductor insulation • Conductors • Earth wire 	

Continued on next page

Photograph of cable	
The sponsor was unable to provide any further information regarding the cable	
Brief description of manufacturing process	See Note 1 below

Note 1: The sponsor was unable to provide this information.

Photographs of Test Specimens

Before test



After test



After test inside box



Test Results

Results

BS EN 50200: 2006 (Resistance to fire with mechanical shock)

When two specimens of the cable junction box utilising the enhanced cable supplied were tested using the principles of the procedure specified in BS EN 50200: 2006, for a period of 120 minutes at a temperature of 830 (+40 –0) °C and a rated voltage of 240V-rms, both the cable specimens and cable junction box maintained their circuit integrity.

BS 8434-2: 2003 + A2 2009 (Resistance to fire with mechanical shock and water spray)

When a specimen of the cable junction box utilising the enhanced cable supplied was tested using the principles of the procedure specified in BS 8434-2: 2003 + A2 2009, at a temperature of 930 (+40 –0) °C and a rated voltage of 240V-rms, but with an exposure time of 120 minutes comprising 60 minutes fire and shock and 60 minutes fire shock and water both the cable specimens and cable junction box maintained their circuit integrity.

Conclusion

When tested using the general principles of BS 5839-1 Section 26.2 e), the cable junction box maintained its integrity for the duration of the tests.

Applicability of test result

The test results relate only to the behaviour of the test specimens of the product under the particular conditions of test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

The test results relate only to the specimens of the product in the form in which they were tested. Small differences in the composition or thickness of the product may significantly affect the performance during the test and may therefore invalidate the test results. Care should be taken to ensure that any product which is supplied or used is fully represented by the specimens which were tested.

Validity

The specification and interpretation of fire test methods are the subject of ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over five years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

This report may only be reproduced in full. Extracts or abridgements shall not be published without permission of **Exova Warringtonfire**.

Revision History

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	